


750 Royal Oaks Drive, Suite 100
Monrovia, California 91016-3629
Tel: (626) 386-1100
Fax: (866) 988-3757
1 800 566 LABS (1 800 566 5227)

Laboratory Report

for

Honolulu Board of Water Supply
630 South Beretania Street
Public Service Bldg." Room 308
Honolulu, HI 96843
Attention: Erwin Kawata

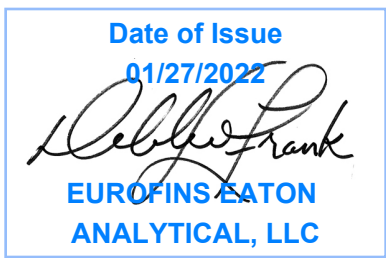

Utah ELCP CA00006

DEB: Debbie L Frank
Project Manager

Report: 979003
Project: RED-HILL
Group: Red-Hill Expanded List (Albuquerque+)

* Accredited in accordance with TNI 2016 and ISO/IEC 17025:2017.

* Laboratory certifies that the test results meet all **TNI 2016 and ISO/IEC 17025:2017** requirements unless noted under the individual analysis.

* As applicable, this report consists of the cover page, State Certification List, ISO 17025 Accredited Method List, Acknowledgement of Samples Received,

Comments, Hits Report, Data Report, QC Summary, QC Report and Regulatory Forms.

* Test results relate only to the sample(s) tested.

* Test results apply to the sample(s) as received, unless otherwise noted in the comments report (ISO/IEC 17025:2017).

STATE CERTIFICATION LIST

State	Certification Number	State	Certification Number
Alabama	41060	Montana	Cert 0035
Arizona	AZ0778	Nebraska	NE-OS-21-13
Arkansas	CA00006	Nevada	CA00006
California	2813	New Hampshire *	2959
Colorado	CA00006	New Jersey *	CA 008
Connecticut	PH-0107	New Mexico	CA00006
Delaware	CA 006	New York *	11320
Florida *	E871024	North Carolina	06701
Georgia	947	North Dakota	R-009
Guam	21-008R	Ohio - 537.1	87786
Hawaii	CA00006	Oregon *	4034
Idaho	CA00006	Pennsylvania *	68-00565
Illinois	200033	Puerto Rico	CA00006
Indiana	C-CA-01	Rhode Island	LAO00326
Iowa – Asbestos	413	South Carolina	87016
Kansas *	E-10268	South Dakota	CA11320
Kentucky	90107	Tennessee	TN02839
Louisiana *	LA008	Texas *	T104704230-20-18
Maine	CA00006	Utah (Primary AB) *	CA00006
Maryland	224	Vermont	VT0114
Marianas Islands	MP0004	Virginia *	460260
Massachusetts	M-CA006	Washington	C838
Michigan	9906	EPA Region 5	CA00006
Mississippi	CA00006	Los Angeles County Sanitation Districts	10264

* NELAP/TNI Recognized Accreditation Bodies

ISO/IEC 17025:2917 Accredited Method List

The test listed below are accredited and met the requirements of ISO/IEC 17025 as verify by A2LA.

Refer to our certificates and scope of accreditations (no. 5890-1 and 5890-2) found at:

<https://www.eurofinsus.com/Eaton>

Test(s)	Method(s)	Potable Water *	Waste Water	Test(s)	Method(s)	Potable Water *	Waste Water
Enterococci	Enterolert	x	x	Gross Alpha coprecipitation	SM 7110 C	x	x
<i>Escherichia coli</i> (Enumeration)	SM 9221 B.1 SM 9221 F	x		Hardness	SM 2340 B	x	x
Fecal Coliform (P/A and Enumeration)	SM 9221 C (MTF/EC), SM 9221 E (MTF/EC)	x	x	Hexavalent Chromium	EPA 218.6,	x	x
Fecal Streptococci and Enterococci	SM 9230 B	x	x	Hexavalent Chromium	EPA 218.7,	x	
Heterotrophic Bacteria	SM 9215 B	x		Hexavalent Chromium	SM 3500-Cr B		x
Legionella	Legiolert®	x		Inorganic Anions and DBPs	EPA 300.0	x	x
<i>Pseudomonas aeruginosa</i>	Idexx Pseudalart	x		Norganic Anions and DBPs	EPA 300.1	x	
Total Coliform (P/A and Enumeration)	SM 9221A, SM 9221B, SM 9221 C	x	x	Kjeldahl Nitrogen	EPA 351.2		x
Total Coliform, Total Coliform with Chlorine Present	SM 9221 B	x	x	Metals	EPA 200.7, EPA200.8	x	x
Total Coliform/E. coli (P/A and Enumeration, Idexx Colilert, Idexx Colilert 18, Colisure)	SM 9223	x		Nitrosamines	EEA-Agilent 521.1 (GCMS-24250)	x	
Total Microcystins and Nodularins	EPA 546	X		Nitrate/Nitrite Nitrogen	EPA 353.2	x	x
Yeast and Mold	SM 9610	x		Odor	SM2150B	x	
1,2,3-Trichloropropane (TCP) at 5 PPT	CA SRL 524M-TCP	x		Organohalide Pesticides and PCB	EPA 505	x	
1,4-Dioxane	EPA 522	x		Ortho Phosphate	SM 4500P E	x	
2,3,7,8-TCDD	Modified EPA 1613 B	x		Oxyhalides Disinfection Byproducts	EPA 317.0	x	
Acrylamide	+ LCMS 2440)	x		Perchlorate	EPA 331.0	x	
Algal Toxins/Microcystin	+ LCMS 3570	x		Perchlorate (Low and High Levels)	EPA 314.0	x	
Alkalinity	SM 2320B	x	x	Perfluorinated Alkyl Acids	EPA 533, EPA 537, EPA 537.1	x	
Ammonia	EPA 350.1, SM 4500-NH3 H		x	PPCP and EDC	+ LCMS-2443	x	
Asbestos	EPA 100.2	x	x	pH	EPA 150.1 SM 4500-H+ B	x	x
Bicarbonate Alkalinity as HCO3	SM 2330 B	x	x	Phenolics – Low Level	+WC 2493 (EPA 420.2 and EPA 420.4 MOD)	x	x
BOD/CBOD	SM 5210 B		x	Phenylurea Pesticides/Herbicides	+ LCMS-2448	x	
Bromate	+ LCMS- 2447	x		Radium-226, Radium-228	GA Tech (Rad-2374)	x	
Carbonate as CO3	SM 2330 B	x	x	Radon-222	SM 7500RN	x	
Carbonyls	EPA 556	x	x	Residue (Filterable)	SM 2540C	x	x
Chemical Oxygen Demand	EPA 410.4, SM 5220D		x	Residue (Non-Filterable)	SM 2540D		x
Chlorinated Acids	EPA 515.4	x		Residue (Total)	SM 2540B		x
Chlorine Dioxide	Palin Test Chlordio X Plus, SM 4500-CLO2 D	x		Residue (Volatile)	EPA 160.4		x
Chlorine, Free, Combined, Total Residual, Chloramines	SM 4500-Cl G	x		Semi-Volatile Compounds	EPA 525.2	x	
Color	SM2120B	x		Silica	SM 4500-SiO2 C	x	x
Conductivity	EPA 120.1, SM 2510B	x	x	Sulfide	SM 4500-S D		x
Corrosivity (Langelier Index), Carbonate as CO3, Hydroxide as OH Calculated	SM 2330 B	x		Sulfite	SM 4500-SO3 B	x	x
Cyanide (Amenable)	SM 4500-CN G	x	x	Surfactants	SM 5540C	x	x
Cyanide (Free)	SM 4500CN F	x	x	Taste and Odor	SM 6040 E	x	
Cyanide (Total)	EPA 335.4	x	x	Total Organic Carbon	SM 5310 C	x	x
Cyanogen Chloride (Screen)	+ 335 Mod (WC-24467)	x		Total Phenols	EPA 420.1		x
Diquat and Paraquat	EPA 549.2	x		Total Phenols	EPA 420.4	x	x
DBP and HAA	SM 6251 B	x		Triazine Pesticides and their Degradates	+ LCMS-3617	x	
Dissolved Organic Carbon	SM 5310 C	x		Turbidity	EPA 180.1	x	x
Dissolved Oxygen	SM 4500-O G		x	Uranium by ICP/MS	EPA 200.8	x	
EDB/DCBP/TCP	EPA 504.1	x		UV 254 Organic Constituents	SM 5910B	x	
EDB/DBCP and Disinfection Byproducts	EPA 551.1	x		VOCs	EPA 524.2	x	
EDTA and NTA	+ WC-2454	x		VOCs	+ (GCMS 2412) by EPA 524.2 modified	x	
Endothall	EPA 548.1, +(LCMS-2445)	x					
Fluoride	SM 4500F C	x	x				
Glyphosate	EPA 547	x					
Glyphosate and AMPA	+ LCMS-3618	x					
Gross Alpha and Gross Beta	EPA 900.0	x	x				

(*) includes: Bottled Water, Drinking Water and Water as Component of Food & Beverage.

(+) In-House Method

Acknowledgement of Samples Received

Addr: **Honolulu Board of Water Supply**
 630 South Beretania Street
 Public Service Bldg." Room 308
 Honolulu, HI 96843

Attn: Erwin Kawata
 Phone: 808-748-5091

Client ID: HONOLULU
 Folder #: 979003
 Project: RED-HILL
 Sample Group: Red-Hill Expanded List (Albuquerque+)

Project Manager: Debbie L Frank
 Phone: (626) 386-1149
 PO #: C20525101 exp 05312023

The following samples were received from you on **January 07, 2022** at **1215**. They have been scheduled for the tests listed below each sample. If this information is incorrect, please contact your service representative. Thank you for using Eurofins Eaton Analytical, LLC.

Sample #	Sample ID	Sample Date
202201070099	KAONOHI WELLS I (331-213) SDWIS PWSID: HI0000331 SDWIS SAMPLE POINT ID: 213 (SUB)Gas Fraction Hydrocarbons TPH 8015 Diesel and Motor Oil TPH 8015 Jet Fuel 5 TPH 8015 Jef Fuel 8	01/06/2022 0855
202201070100	TRAVEL BLANK::KAONOHI WELLS I (331-213) (SUB)Gas Fraction Hydrocarbons	01/06/2022 0855
202201070101	KAAMILO WELLS (Kaamilo Chlor, booster building basement)(331-261) SDWIS PWSID: HI0000331 SDWIS SAMPLE POINT ID: 261 (SUB)Gas Fraction Hydrocarbons TPH 8015 Diesel and Motor Oil TPH 8015 Jet Fuel 5 TPH 8015 Jef Fuel 8	01/06/2022 0830
202201070102	TRAVEL BLANK::KAAMILO WELLS (Kaamilo Chlor, booster building basement) (331-261) (SUB)Gas Fraction Hydrocarbons	01/06/2022 0830

Test Description



Eaton Analytical

CHAIN OF CUSTODY RECORD

EUROFINS EATON ANALYTICAL USE ONLY:

750 Royal Oaks Drive, Suite 100
 Monrovia, CA 91016-3629
 Phone: 626 386 1100
 Fax: 626 386 1101
 800 566 LABS (800 566 5227)

LOGIN COMMENTS: _____

SAMPLES CHECKED AGAINST COC BY: 479109

SAMPLES LOGGED IN BY: 479109

SAMPLE TEMP RECEIVED AT: _____ °C (Compliance: 4 ± 2 °C)
 Colton / No. California / Arizona
 Monrovia

SAMPLES REC'D DAY OF COLLECTION? (check for yes)

CONDITION OF BLUE ICE: Frozen 1.6 °C (Compliance: 4 ± 2 °C)
 Partially Frozen _____ Thawed _____ Wet Ice _____ No Ice _____

METHOD OF SHIPMENT: Pick-Up / Walk-In / FedEx / UPS / DHL / Area Fast / Top Line / Other: _____

TO BE COMPLETED BY SAMPLER:

COMPANY/AGENCY NAME: BWS HONOLULU

PROJECT CODE: Red Hill

COMPLIANCE SAMPLES **NON-COMPLIANCE SAMPLES** (check for yes)

EEA CLIENT CODE: Honolulu **COC ID:** _____

COMPLIANCE SAMPLES - Requires state forms
 Type of samples (circle one): ROUTINE SPECIAL CONFIRMATION (eg. SDWA, Phase V, NPDES, FDA,...)

SAMPLE GROUP: _____ **SEE ATTACHED BOTTLE ORDER FOR ANALYSES** (check for yes), **OR**

TAT requested: rush by adv notice only STD ___ 1 wk ___ X ___ 3 day ___ 2 day ___ 1 day ___


SAMPLE DATE	SAMPLE TIME	SAMPLE ID	CLIENT LAB ID	MATRIX	FIELD DATA	FIELD DATA	WEEKLY RED HILL	SAMPLER COMMENTS
1-6-22	0855	KAONOHI WELLS I	HI0000331-213	CFW			X	
1-6-22	0830	KAAMILO WELLS (Kaamilo Chlor, booster building basement)	HI0000331-261	CFW			X	
		Temperature Blank						

list ANALYSES REQUIRED (enter number of bottles sent for each test for each sample)

Temp Blank: 1.0 °C

*** MATRIX TYPES:** RSW = Raw Surface Water CFW = Chlor(am)inated Finished Water SEAW = Sea Water BW = Bottled Water SO = Soil O = Other - Please Identify
 RGW = Raw Ground Water FW = Other Finished Water WW = Waste Water SW = Storm Water SL = Sludge

SAMPLED BY:	SIGNATURE	PRINT NAME	COMPANY/TITLE	DATE	TIME
RELINQUISHED BY:	<u>Derek Dotson</u>	Derek Dotson	Honolulu Board of Water Supply	1-6-2022	
RECEIVED BY:	<u>Chris Bauck</u>	Derek Dotson	Honolulu Board of Water Supply	1-6-2022	12:00
RELINQUISHED BY:				1-7-22	12:15
RECEIVED BY:					



Kit Order for Honolulu Board of Water Supply

Eaton Analytical

Debbie L Frank is your Eurofins Eaton Analytical, LLC Service Manager

750 Royal Oaks Drive, Suite 100
Monrovia, California 91016-3629
(626) 386-1100 FAX (866) 988-3757

Created Date & Time: 12/13/2021 1:02:47PM

Note: Sampler Please return this paper with your samples

Kit #: 307858

Client ID: HONOLULU

Created By: Debbie L Frank - [DEB]
Deliver By: 12/20/2021
STG: Bottle Orders
Ice Type: G

Project Code: RED-HILL Bottle Orders
Group Name: RED-HILL-INCIDENT Stock
PO#/JOB#: C20625101 exp 05312023
Description: STOCK - RED-HILL Incident 2021

Ship Sample Kits to
Honolulu Board of Water Supply
630 South Beretania Street
Chemistry Lab
Honolulu, HI 96843
Attr: Ron Fenstermacher
Phone: 808-748-5841
Fax: 808-550-5572

Send Report to
Honolulu Board of Water Supply
630 South Beretania Street
Public Service Bldg. Room 308
Honolulu, HI 96843
Attr: Erwin Kawata
Phone: 808-748-5091
Fax: 808-550-5018

Billing Address
Honolulu Board of Water Supply
630 South Beretania Street
Public Service Bldg. Room 308
Honolulu, HI 96843
Attr: Erwin Kawata
Phone: 808-748-5091
Fax: 808-550-5018

# of Sample Tests	Bottle Qty - Type [preservative information]	Total	UN DOT #
3	@625A_Phyeis-C_@625BN_Phyeis-C_@625PAT_Physis_TICS-C 4- 4L amber glass [1 ml Thio 8%]	12	
1-2	TPH 8015 Diesel and Motor Oil_C, TPH 8015 Jet Fuel 5_C, TPH 8015 Jet Fuel 8_C	9	
1-2	8015 Gas_C	9	
1-2	8015 Gas_C TB	6	
3	@VQASDWA-C plus plus TICs-TBC	9	UN1789
3	@VQASDWA-C plus plus TICs C	9	UN1789
3	@8015-Ethanol_Subbed	12	
Sum Tests: 21		Sum Bottles: 66	

Comments

Shipping
Ship in 3 separate coolers
Pack in sets 1 Field Sample + 1 TB in each cooler
Label Cooler: 8015+
Sampler:
Follow chlorinated sampling procedure regardless of site type.
after 3 months - kit is only good for Raw water site. request new kits for Treated water site if kit is >3mos old form creation date.
Request replacement stock via Email if using last kit.



Eaton Analytical

INTERNAL CHAIN OF CUSTODY RECORD

EEA Folder Number: 4741657

SAMPLE TEMP RECEIVED:

Note: if samples are out of temperature range, let the ASMs know. ASMs will determine whether to proceed with analysis or not.

SAMPLES REC'D DAY OF COLLECTION? Yes / No

IR Gun ID = 401 (Observation = 1.8 °C) (Corr.Factor = 0.12 °C) (Final = 1.6 °C)

TYPE OF ICE: Real Synthetic No Ice Partially Frozen Thawed N/A

METHOD OF SHIPMENT: Pick-Up / Walk-In / FedEx / UPS / DHL / Area Fast / Top Line / Other:

Compliance Acceptance Criteria:

- 1) Chemistry: >0, ≤6°C, not frozen (NELAP) (if received after 24 hrs of sample collection)
- 2) Microbiology, Distribution: < 10°C, not frozen (can be ≥10°C if received on ice the same day as sample collection, within 8 hours)
- 3) Microbiology, Surface Water: < 10°C (if received after 2 hours of sample collection)

If out of temperature range for both Chemistry and Microbiology samples and temperature does not confirm, then measure the temperature of each quadrant and record each temperature of the quadrants

1 = (Observation = _____ °C) (Corr.Factor = _____ °C) (Final = _____ °C)	2 = (Observation = _____ °C) (Corr.Factor = _____ °C) (Final = _____ °C)
3 = (Observation = _____ °C) (Corr.Factor = _____ °C) (Final = _____ °C)	4 = (Observation = _____ °C) (Corr.Factor = _____ °C) (Final = _____ °C)

4 Dioxin (1613 or 2,3,7,8 TCDD): must be between 0-4 °C, not frozen (if received after 24 hrs of sample collection)

5) pH Check. Manufacturer: _____ Lot Number: _____ pH strip type: 0 - 14 or _____ Expiration Date _____ Results: _____

6) Chlorine check. Manufacturer: Sansafe. Lot No.: _____ Expiration Date: _____ Results _____

VOA and Radon Headspace: No Samples with Headspace: Samples with Headspace (see below):

Headspace Documentation (use additional VOC and Radon Internal COFC for additional bottles)

Exempt from headspace concerns: Methods 515.4, HAA(6251,552), 505, SPME, @CH, 532LCMS, 556, 536, Anatoxin, LCMS methods using 40 ml vials, International clients:

Samp ID	Bottle #	None/<6 mm	>6mm	Test	Samp ID	Bottle #	None/<6 mm	>6mm	Test

Note Sample IDs which have dissimilar headspace (i.e. potential sampling errors): _____

RECEIVED BY: Chris Broek SIGNATURE: Chris Broek PRINT NAME: Eurofins Eaton Analytical COMPANY/TITLE: Eurofins Eaton Analytical DATE: 1.7.22 TIME: 12:15

SAMPLES CHECKED AGAINST COC BY: _____ SIGNATURE: _____ PRINT NAME: Eurofins Eaton Analytical COMPANY/TITLE: Eurofins Eaton Analytical DATE: _____ TIME: _____



Eaton Analytical

INTERNAL CHAIN OF CUSTODY RECORD

EEA Folder Number: 541057

SAMPLE TEMP RECEIVED:

Note: If samples are out of temperature range, let the ASMs know. ASMs will determine whether to proceed with analysis or not.

SAMPLES REC'D DAY OF COLLECTION? Yes / No

IR Gun ID = 401 (Observation = 27 °C) (Corr. Factor = 0.2 °C) (Final = 2.5 °C)

TYPE OF ICE: Real Synthetic No Ice Frozen Partially Frozen Thawed N/A

METHOD OF SHIPMENT: Pick-Up / Walk-In / FedEx UPS / DHL / Area Fast / Top Line / Other: _____

Compliance Acceptance Criteria:

- 1) Chemistry: >0, ≤6°C, not frozen (NELAP) (if received after 24 hrs of sample collection)
- 2) Microbiology, Distribution: < 10°C, not frozen (can be ≥10°C if received on ice the same day as sample collection, within 8 hours)
- 3) Microbiology, Surface Water: < 10°C (if received after 2 hours of sample collection)

If out of temperature range for both Chemistry and Microbiology samples and temperature does not confirm, then measure the temperature of each quadrant and record each temperature of the quadrants

1 = (Observation = _____ °C) (Corr. Factor = _____ °C) (Final = _____ °C)	2 = (Observation = _____ °C) (Corr. Factor = _____ °C) (Final = _____ °C)
3 = (Observation = _____ °C) (Corr. Factor = _____ °C) (Final = _____ °C)	4 = (Observation = _____ °C) (Corr. Factor = _____ °C) (Final = _____ °C)

- 4) Dioxin (1613 or 2,3,7,8 TCDD): must be between 0-4 °C, not frozen (if received after 24 hrs of sample collection)
- 5) pH Check. Manufacturer: _____ Lot Number: _____ pH strip type: 0 - 14 or _____ Expiration Date: _____ Results: _____
- 6) Chlorine check. Manufacturer: Sansafe. Lot No.: _____ Expiration Date: _____ Results: _____

7) VOA and Radon Headspace: No Samples with Headspace: Samples with Headspace (see below):

Headspace Documentation (use additional VOC and Radon Internal COFC for additional bottles)

Exempt from headspace concerns: Methods 515.4, HAA(6251,552), 505, SPME, @CH, 532LCMS, 556, 536, Anatoxin, LCMS methods using 40 ml vials, International clients: None/<6 mm

Samp ID	Bottle #	None/<6 mm	>6mm	Test	Samp ID	Bottle #	None/<6 mm	>6mm	Test

Note Sample IDs which have dissimilar headspace (i.e. potential sampling errors): _____

RECEIVED BY: Chris Green SIGNATURE: Chris Green PRINT NAME: Chris Green COMPANY/TITLE: Eurofins Eaton Analytical DATE: 11-7-22 TIME: 1230

SAMPLES CHECKED AGAINST COC BY: _____ SIGNATURE: _____ PRINT NAME: Eurofins Eaton Analytical COMPANY/TITLE: Eurofins Eaton Analytical DATE: _____ TIME: _____

ORIGIN ID:HIKA (808) 748-5840
BWS CHEM LAB
HONOLULU BOARD OF WATER SUPPLY
630 S. BERETANIA ST
CHEMICAL LABORATORY
HONOLULU, HI 96843
UNITED STATES US

SHIP DATE: 06JAN22
ACTWGT: 80.00 LB
CAD: 100205419/N/ET74400
BILL RECIPIENT

TO C CHUCK

EUROFINS EATON ANALYTICAL, INC

750 ROYAL OAKS DR


SUITE 100

MONROVIA CA 91016

REF: (926) 386-1178

INV:

DEPT:

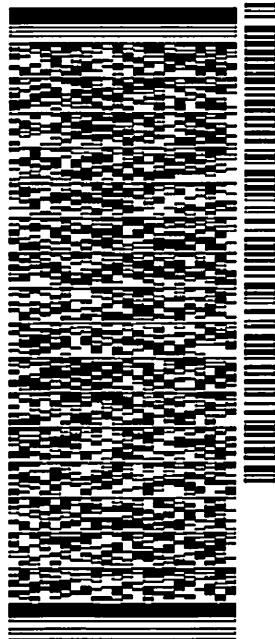

56DJ201EF/FE4A

5 of 5

MPS# 7756 8459 9808


Mstr# 7756 8459 9153

FRI - 07 JAN 10:30A
PRIORITY OVERNIGHT

0201

WZ WHPA

91016
CA-US BUR

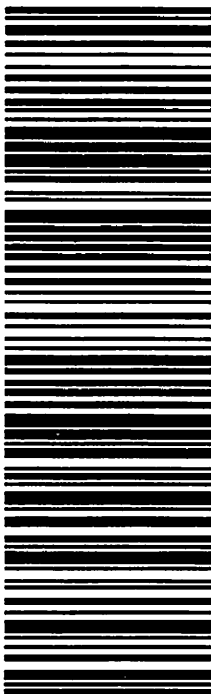

After printing this label:

1. Use the 'Print' button on this page to print your label to your laser or inkjet printer.
2. Fold the printed page along the horizontal line.
3. Place label in shipping pouch and affix it to your shipment so that the barcode portion of the label can be read and scanned.

Warning: Use only the printed original label for shipping. Using a photocopy of this label for shipping purposes is fraudulent and could result in additional billing charges, along with the cancellation of your FedEx account number.

Use of this system constitutes your agreement to the service conditions in the current FedEx Service Guide, available on fedex.com. FedEx will not be responsible for any claim in excess of \$100 per package, whether the result of loss, damage, delay, non-delivery, misdelivery, or misinformation, unless you declare a higher value, pay an additional charge, document your actual loss and file a timely claim. Limitations found in the current FedEx Service Guide apply. Your right to recover from FedEx for any loss, including intrinsic value of the package, loss of sales, income interest, profit, attorney's fees, costs, and other forms of damage whether direct, incidental, consequential, or special is limited to the greater of \$100 or the authorized declared value. Recovery cannot exceed actual documented loss. Maximum for items of extraordinary value is \$1,000, e.g. jewelry, precious metals, negotiable instruments and other items listed in our Service Guide. Written claims must be filed within strict time limits, see current FedEx Service Guide.

ORIGIN: DHIKA (808) 748-5840
BWS CHEMILAB
HONOLULU BOARD OF WATER SUPPLY
630 S. BERETANIA ST
CHEMICAL LABORATORY
HONOLULU, HI 96843
UNITED STATES US

SHIP DATE: 06JAN22
ACTWGT: 60.00 LB
CAD: 100205419/NET4400
BILL RECIPIENT


TO C CHUCK

EUROFINS EATON ANALYTICAL, INC
750 ROYAL OAKS DR
SUITE 100

MONROVIA CA 91016

REF: (626) 386-1178
INV: PO: DEPT:

56DJ201EF/FE4A

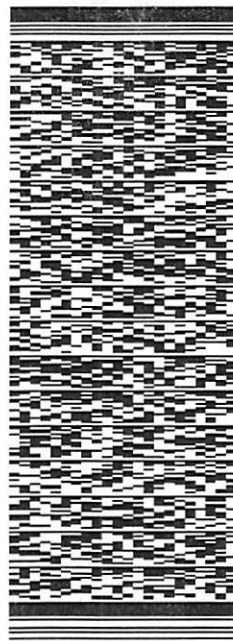

4 of 5

FRI - 07 JAN 10:30A
PRIORITY OVERNIGHT

MPS# 7756 8459 7275
0263
Mstr# 7756 8459 9153

0201

WZ WHPA

91016
CA-US BUR



After printing this label:

1. Use the 'Print' button on this page to print your label to your laser or inkjet printer.
2. Fold the printed page along the horizontal line.
3. Place label in shipping pouch and affix it to your shipment so that the barcode portion of the label can be read and scanned.

Warning: Use only the printed original label for shipping. Using a photocopy of this label for shipping purposes is fraudulent and could result in additional billing charges, along with the cancellation of your FedEx account number.

Use of this system constitutes your agreement to the service conditions in the current FedEx Service Guide, available on fedex.com. FedEx will not be responsible for any claim in excess of \$100 per package, whether the result of loss, damage, delay, non-delivery, misdelivery, or misinformation, unless you declare a higher value, pay an additional charge, document your actual loss and file a timely claim. Limitations found in the current FedEx Service Guide apply. Your right to recover from FedEx for any loss, including intrinsic value of the package, loss of sales, income interest, profit, attorney's fees, costs, and other forms of damage whether direct, incidental, consequential, or special is limited to the greater of \$100 or the authorized declared value. Recovery cannot exceed actual documented loss. Maximum for items of extraordinary value is \$1,000, e.g. jewelry, precious metals, negotiable instruments and other items listed in our Service Guide. Written claims must be filed within strict time limits, see current FedEx Service Guide.

Tel: (626) 386-1100
Fax: (866) 988-3757
1 800 566 LABS (1 800 566 5227)

Laboratory Comments

Report: 979003
Project: RED-HILL
Group: Red-Hill Expanded List
(Albuquerque+)

Honolulu Board of Water Supply
Erwin Kawata
630 South Beretania Street
Public Service Bldg." Room 308
Honolulu, HI 96843

Folder Comments

Analytical results for Gasoline, Diesel, Motor Oil, and Jet Fuels are submitted by EMAX Laboratories, Torrance, CA



Eaton Analytical

Tel: (626) 386-1100
Fax: (866) 988-3757
1 800 566 LABS (1 800 566 5227)

Laboratory Hits

Report: 979003
Project: RED-HILL
Group: Red-Hill Expanded List
(Albuquerque+)

Honolulu Board of Water Supply
Erwin Kawata
630 South Beretania Street
Public Service Bldg." Room 308
Honolulu, HI 96843

Samples Received on:
01/07/2022 1215

Analyzed	Analyte	Sample ID	Result	HI Limit	Units	MRL
----------	---------	-----------	--------	----------	-------	-----

SUMMARY OF POSITIVE DATA ONLY

Tel: (626) 386-1100
 Fax: (866) 988-3757
 1 800 566 LABS (1 800 566 5227)

Report: 979003
Project: RED-HILL
Group: Red-Hill Expanded List
 (Albuquerque+)

Honolulu Board of Water Supply
 Erwin Kawata
 630 South Beretania Street
 Public Service Bldg.™ Room 308
 Honolulu, HI 96843

Samples Received on:
 01/07/2022 12:15

Prepped	Analyzed	Prep Batch	Analytical Batch	Method	Analyte	Result	Units	MRL	Dilution
<u>KAONOHI WELLS I (331-213) (202201070099)</u>						Sampled on 01/06/2022 0855			
Sample Point ID: 213									
PWSID: HI0000331									
SW 8015B - (SUB)Gas Fraction Hydrocarbons									
01/11/22	01/11/22 22:09			(SW 8015B)	(SUB)Gas Fraction Hydrocarbons	ND	mg/L	0.02	1
SW 8015B - TPH 8015 Diesel and Motor Oil									
01/12/22	01/13/22 17:41			(SW 8015B)	TPH Diesel	ND	mg/L	0.027	1
01/12/22	01/13/22 17:41			(SW 8015B)	TPH Motor Oil	ND	mg/L	0.054	1
EPA 8015 - Jet Fuel 5 C8-C18									
01/12/22	01/13/22 17:41			(EPA 8015)	Jet Fuel 5	ND	mg/L	0.054	1
EPA 8015 - Jet Fuel 8 C8-C18									
	01/13/22 17:41			(EPA 8015)	Jet Fuel 8	ND	mg/L	0.054	1
<u>TRAVEL BLANK::KAONOHI WELLS I (331-213) (202201070100)</u>						Sampled on 01/06/2022 0855			
SW 8015B - (SUB)Gas Fraction Hydrocarbons									
01/11/22	01/11/22 22:45			(SW 8015B)	(SUB)Gas Fraction Hydrocarbons	ND	mg/L	0.02	1
<u>KAAMILO WELLS (Kaamilo Chlor, booster building basement)(331-261) (202201070101)</u>						Sampled on 01/06/2022 0830			
Sample Point ID: 261									
PWSID: HI0000331									
SW 8015B - (SUB)Gas Fraction Hydrocarbons									
01/12/22	01/12/22 00:34			(SW 8015B)	(SUB)Gas Fraction Hydrocarbons	ND	mg/L	0.02	1
SW 8015B - TPH 8015 Diesel and Motor Oil									
01/12/22	01/13/22 17:58			(SW 8015B)	TPH Diesel	ND	mg/L	0.025	1
01/12/22	01/13/22 17:58			(SW 8015B)	TPH Motor Oil	ND	mg/L	0.05	1
EPA 8015 - Jet Fuel 5 C8-C18									
01/12/22	01/13/22 17:58			(EPA 8015)	Jet Fuel 5	ND	mg/L	0.05	1
EPA 8015 - Jet Fuel 8 C8-C18									
	01/13/22 17:58			(EPA 8015)	Jet Fuel 8	ND	mg/L	0.05	1
<u>TRAVEL BLANK::KAAMILO WELLS (Kaamilo Chlor, booster building basement) (331-261) (202201070102)</u>						Sampled on 01/06/2022 0830			
SW 8015B - (SUB)Gas Fraction Hydrocarbons									
01/12/22	01/12/22 01:11			(SW 8015B)	(SUB)Gas Fraction Hydrocarbons	ND	mg/L	0.02	1

Rounding on totals after summation.
 (c) - indicates calculated results. Analysis is a calculated result. Reported results are not rounded until the final step before reporting. Therefore methods that use a test result with further calculation may have slight differences in final result than the component analyses.



LABORATORIES, INC.

3051 Fujita Street
Torrance, CA 90505
Tel: (310)-618-8889

Date: 01-24-2022
EMAX Batch No.: 22A078

Attn: Jackie Contreras

Eurofins Eaton Analytical
750 Royal Oaks Dr., Suite 100
Monrovia, CA 91016-3629

Subject: Laboratory Report
Project: 979003


Enclosed is the Laboratory report for samples received on 01/11/22.
The data reported relate only to samples listed below :

Sample ID	Control #	Col Date	Matrix	Analysis
202201070099	A078-01	01/06/22	WATER	TPH GASOLINE TPH
202201070100	A078-02	01/06/22	WATER	TPH GASOLINE
202201070101	A078-03	01/06/22	WATER	TPH GASOLINE TPH
202201070102	A078-04	01/06/22	WATER	TPH GASOLINE

The results are summarized on the following pages.

Please feel free to call if you have any questions concerning these results.


Sincerely yours,

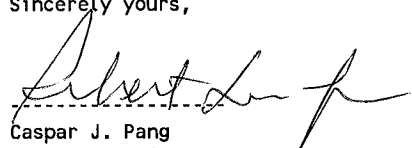
Caspar J. Pang
Laboratory Director

This report is confidential and intended solely for the use of the individual or entity to whom it is addressed. This report shall not be reproduced except in full or without the written approval of EMAX.

EMAX certifies that results included in this report meets all TNI & DOD requirements unless noted in the Case Narrative.

NELAP Accredited Certificate Number CA002912021-19
ANAB Accredited DoD ELAP and ISO/IEC 17025 Certificate Number L2278 Testing
California ELAP Accredited Certificate Number 2672



Eaton Analytical

Ship To: EMAX Laboratories, Inc. 3051 Fujita St. Torrance, CA 90505

Phone: 310-618-8889 Fax: 310-618-0818

Folder #: 979003 Report Due: 01/14/2022

Sample ID: 202201070099 Client Sample ID for reference on: KAONOHI WELLS I (331-213)

Sample type: Sample Event: Analysis Requested

Table with 2 columns: Method, Prep Method. Rows include SW 8015B, SW 8015B, EPA 8015, EPA 8015 and their corresponding prep methods.

Sample ID: 202201070100 Client Sample ID for reference on: TRAVEL BLANK: KAONOHI WELLS I (331-213)

Sample type: Sample Event: Analysis Requested

Table with 2 columns: Method, Prep Method. Row includes SW 8015B and EPA 5030C.

3 day rush

Reports: Jackie Contreras Sub-Contracting Administrator... Eurofins Eaton Analytical, LLC 750 Royal Oaks Drive, Suite 100, Monrovia, CA 91016

Provide in each Report the Specified State Certification # and Exp Date for requested tests + matrix. Samples from: HAWAII

Submittal Form 22 A078 Date: 1/11/2022 *REPORTING REQUIREMENTS: Do Not Combine Reports with any other samples submitted under different Folder Numbers!

Sample Date & Time Matrix 01/06/22 0855 DW PWSID JLS

Facility ID: Sample Point ID: Static ID:

Sample Date & Time Matrix 01/06/22 0855 DW PWSID JLS

Facility ID: Sample Point ID: Static ID:

Relinquished by: [Signature] Date: 1/11/22 Time: 11:12 Sample Control. Received by: [Signature] Date: 1/11/22 Time: 11:12 Sample Control.

NOTIFICATION REQUIRED IF RECEIVED OUTSIDE OF 0-6 CELSIUS. An Acknowledgement of Receipt is requested to attn: Jackie Contreras Temp: 4.4°

22A078

Sample ID 202201070101 (3) **Client Sample ID for reference on!** KAAMILO WELLS (Kaamilo Chlor, booster building basement)(331-261) **Sample Date & Time** 01/06/22 0830 **Matrix** DW **Clip Code** **PWSID** JLS
Sample type: **Sample Event:** **Facility ID:** **Sample Point ID:** **Static ID:**

Method	Prep Method	Analysis Requested
SW 8015B	EPA 5030C	(SUB)Gas Fraction Hydrocarbons
SW 8015B	EPA 3550B	TPH 8015 Diesel and Motor Oil
EPA 8015	EPA 8015	Jet Fuel 5 C8-C18
EPA 8015		Jet Fuel 8 C8-C18

Sample ID 202201070102 (4) **Client Sample ID for reference on!** TRABEL BLANK:KAAMILO WELLS (Kaamilo Chlor, booster building basement) **Sample Date & Time** 01/06/22 0830 **Matrix** DW **Clip Code** **PWSID** JLS
Sample type: **Sample Event:** **Facility ID:** **Sample Point ID:** **Static ID:**

Method	Prep Method	Analysis Requested
SW 8015B	EPA 5030C	(SUB)Gas Fraction Hydrocarbons

Relinquished by: Xen **Sample Control** **Date** 1/12/22 **Time** 1112
Received by: _____ **Date** _____ **Time** _____
Relinquished by: [Signature] **Sample Control** **Date** 1/12/22 **Time** 1112
Received by: _____ **Date** _____ **Time** _____

NOTIFICATION REQUIRED IF RECEIVED OUTSIDE OF 0-6 CELSIUS
 An Acknowledgement of Receipt is requested to attn: Jackie Contreras

Type of Delivery	Airbill / Tracking Number	ECN 22 A078
<input type="checkbox"/> Fedex <input type="checkbox"/> UPS <input type="checkbox"/> GSO <input type="checkbox"/> Others		Recipient Cecilia Chavez
<input type="checkbox"/> EMAX Courier <input checked="" type="checkbox"/> Client Delivery		Date 01/11/22 Time 11:12

COC INSPECTION

<input checked="" type="checkbox"/> Client Name	<input checked="" type="checkbox"/> Client PM/FC	<input type="checkbox"/> Sampler Name	<input checked="" type="checkbox"/> Sampling Date/Time	<input checked="" type="checkbox"/> Sample ID	<input checked="" type="checkbox"/> Matrix
<input checked="" type="checkbox"/> Address	<input checked="" type="checkbox"/> Tel # / Fax #	<input type="checkbox"/> Courier Signature	<input checked="" type="checkbox"/> Analysis Required	<input type="checkbox"/> Preservative (if any)	<input checked="" type="checkbox"/> TAT
Safety Issues (if any)	<input type="checkbox"/> High concentrations expected	<input type="checkbox"/> From Superfund Site	<input type="checkbox"/> Rad screening required		

Note: _____


PACKAGING INSPECTION

Container	<input checked="" type="checkbox"/> Cooler	<input type="checkbox"/> Box	<input type="checkbox"/> Other
Condition	<input type="checkbox"/> Custody Seal	<input type="checkbox"/> Intact	<input type="checkbox"/> Damaged
Packaging	<input checked="" type="checkbox"/> Bubble Pack	<input type="checkbox"/> Styrofoam	<input type="checkbox"/> Popcorn
Temperatures (Cool, ≤6 °C but not frozen)	<input type="checkbox"/> Cooler 1 _____ °C	<input checked="" type="checkbox"/> Cooler 2 4.4 °C	<input type="checkbox"/> Cooler 3 _____ °C
Thermometer: A - S/N 210191066 a 11/11/22	<input type="checkbox"/> Cooler 6 _____ °C	<input type="checkbox"/> Cooler 7 _____ °C	<input type="checkbox"/> Cooler 4 _____ °C
	<input type="checkbox"/> Cooler 8 _____ °C	<input type="checkbox"/> Cooler 9 _____ °C	<input type="checkbox"/> Cooler 5 _____ °C
	<input type="checkbox"/> Cooler 10 _____ °C		<input type="checkbox"/> Cooler 10 _____ °C

Comments: Temperature is out of range. PM was informed IMMEDIATELY.

Note: _____

DISCREPANCIES

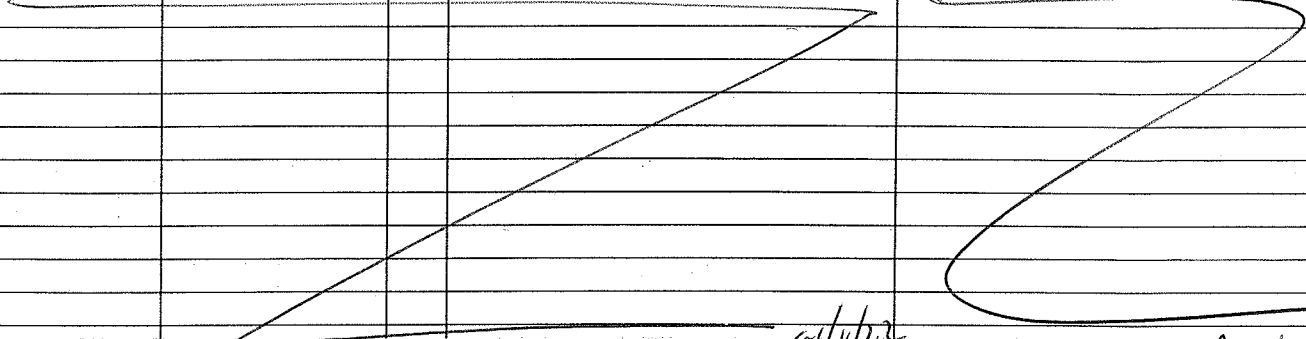LabSampleID	LabSampleContainerID	Code	ClientSample Label ID / Information	Corrective Action
1, 3	4-7, 13-16	D22		RS
				
			a 1/11/22	RS 1/12/22

pH holding time requirement for water samples is 15 mins. Water samples for pH analysis are received beyond 15 minutes from sampling time.

NOTES/OBSERVATIONS:

LEGEND:

Code Description- Sample Management

- D1 Analysis is not indicated in _____
- D2 Analysis mismatch COC vs label
- D3 Sample ID mismatch COC vs label
- D4 Sample ID is not indicated in _____
- D5 Container -[improper] [leaking] [broken]
- D6 Date/Time is not indicated in _____
- D7 Date/Time mismatch COC vs label
- D8 Sample listed in COC is not received
- D9 Sample received is not listed in COC
- D10 No initial/date on corrections in COC/label
- D11 Container count mismatch COC vs received
- D12 Container size mismatch COC vs received

Code Description-Sample Management

- D13 Out of Holding Time
- D14 Bubble is >6mm
- D15 No trip blank in cooler
- D16 Preservation not indicated in _____
- D17 Preservation mismatch COC vs label
- D18 Insufficient chemical preservative
- D19 Insufficient Sample
- D20 No filtration info for dissolved analysis
- D21 No sample for moisture determination
- D22 Jet Fuel 8 Analysis not indicated on label
- D23 _____
- D24 _____

Continue to next page.

Code Description-Sample Management

- R1 Proceed as indicated in COC Label
- R2 Refer to attached instruction
- R3 Cancel the analysis
- R4 Use vial with smallest bubble first
- R5 Log-in with latest sampling date and time+1 min
- R6 Adjust pH as necessary
- R7 Filter and preserved as necessary
- R8 Informed Client
- R9 _____
- R10 _____
- R11 _____
- R12 _____

REVIEWS:

Sample Labeling Maria Rivera / Cecilia Chavez
Date 01/11/22 / 1/11/22

SRF [Signature]
Date 1/11/22

PM [Signature]
Date 1/12/22

REPORTING CONVENTIONS

DATA QUALIFIERS:

Lab Qualifier	AFCEE Qualifier	Description
J	F	Indicates that the analyte is positively identified and the result is less than RL but greater than MDL.
N		Indicates presumptive evidence of a compound.
B	B	Indicates that the analyte is found in the associated method blank as well as in the sample at above QC level.
E	J	Indicates that the result is above the maximum calibration range or estimated value.
*	*	Out of QC limit.

Note: The above qualifiers are used to flag the results unless the project requires a different set of qualification criteria.

ACRONYMS AND ABBREVIATIONS:

CRDL	Contract Required Detection Limit
RL	Reporting Limit
MRL	Method Reporting Limit
PQL	Practical Quantitation Limit
MDL	Method Detection Limit
DO	Diluted out

DATES

The date and time information for leaching and preparation reflect the beginning date and time of the procedure unless the method, protocol, or project specifically requires otherwise.

LABORATORY REPORT FOR

EUROFINS EATON ANALYTICAL

979003

METHOD 5030B/8015B
TOTAL PETROLEUM HYDROCARBONS BY PURGE AND TRAP

SDG#: 22A078

CASE NARRATIVE

Client : EUROFINS EATON ANALYTICAL

Project: 979003

SDG : 22A078

METHOD 5030B/8015B
TOTAL PETROLEUM HYDROCARBONS BY PURGE AND TRAP

A total of four(4) water samples were received on 01/11/22 to be analyzed for Total Petroleum Hydrocarbons by Purge and Trap in accordance with Method 5030B/8015B and project specific requirements.

Holding Time

Samples were analyzed within the prescribed holding time.

Calibration

Multi-calibration points were generated to establish initial calibration (ICAL). ICAL was verified using a secondary source (ICV). Continuing calibration (CCV) verifications were carried out on a frequency specified by the project. All calibration requirements were within acceptance criteria. Refer to calibration summary forms of ICAL, ICV and CCV for details. MRL was analyzed as required by the project. Refer to MRL summary form for details.

Method Blank

Method blank was prepared and analyzed at the frequency required by the project. For this SDG, one(1) method blank was analyzed. VG39A06B - result was compliant to project requirement. Refer to sample result summary form for details.

Lab Control Sample

Lab control sample was prepared and analyzed at a frequency required by the project. For this SDG, one(1) set of LCS/LCD was analyzed. VG39A06L/VG39A06C were within LCS limits. Refer to LCS summary form for details.

Matrix QC Sample

No matrix QC sample was provided on this SDG. Gasoline was within MS QC limits in A063-01M/A063-01S. Refer to Matrix QC summary form for details.

Surrogate

Surrogate was added on QC and field samples. All surrogate recoveries were within QC limits. Refer to sample result summary forms for details.

Sample Analysis

Samples were analyzed according to prescribed analytical procedures. Results were evaluated in accordance to project requirements. For this SDG, all quality control requirements were met.

LAB CHRONICLE
TOTAL PETROLEUM HYDROCARBONS BY PURGE AND TRAP

Client : EUROFINS EATON ANALYTICAL
Project : 979003

SDG NO. : 22A078
Instrument ID : GCT039

Client Sample ID	Laboratory Sample ID	Dilution Factor	% Moist	WATER		Extraction Date/Time	Sample Data FN	Calibration Data FN	Prep. Batch	Notes
				Analysis Date/Time	Date/Time					
MBLK1W	VG39A06B	1	NA	01/11/2212:24	01/11/2212:24	EA11005A	EA11003A	EA11003A	22VG39A06	Method Blank
LCS1W	VG39A06L	1	NA	01/11/2213:00	01/11/2213:00	EA11006A	EA11003A	EA11003A	22VG39A06	Lab Control Sample (LCS)
LCD1W	VG39A06C	1	NA	01/11/2213:37	01/11/2213:37	EA11007A	EA11003A	EA11003A	22VG39A06	LCS Duplicate
202201070099	A078-01	1	NA	01/11/2222:09	01/11/2222:09	EA11021A	EA11012A	EA11012A	22VG39A06	Field Sample
202201070100	A078-02	1	NA	01/11/2222:45	01/11/2222:45	EA11022A	EA11012A	EA11012A	22VG39A06	Field Sample
202201070101	A078-03	1	NA	01/12/2200:34	01/12/2200:34	EA11025A	EA11023A	EA11023A	22VG39A06	Field Sample
202201070102	A078-04	1	NA	01/12/2201:11	01/12/2201:11	EA11026A	EA11023A	EA11023A	22VG39A06	Field Sample

FN - Filename
% Moist - Percent Moisture

SAMPLE RESULTS

METHOD 5030B/8015B
TOTAL PETROLEUM HYDROCARBONS BY PURGE AND TRAP

```

=====
Client       : EUROFINS EATON ANALYTICAL   Date Collected: 01/06/22 08:55
Project      : 979003                     Date Received: 01/11/22
Batch No.    : 22A078                     Date Extracted: 01/11/22 22:09
Sample ID    : 202201070099              Date Analyzed: 01/11/22 22:09
Lab Samp ID  : A078-01                   Dilution Factor: 1
Lab File ID  : EA11021A                  Matrix: WATER
Ext Btch ID  : 22VG39A06                 % Moisture: NA
Calib. Ref. : EA11012A                   Instrument ID: 39
=====

```

PARAMETERS	RESULTS (mg/L)	RL (mg/L)	MDL (mg/L)		
GASOLINE	ND	0.020	0.010		
SURROGATE PARAMETERS	RESULT	SPK_AMT	%RECOVERY	QC LIMIT	
Bromofluorobenzene	0.0323	0.0400	81	60-140	

Notes:

Parameter H-C Range
Gasoline C6-C10

Reported ND at RL quantitated per pattern recognition.

Detection limits are reported relative to sample result significant figures.

Sample Amount : 5ml Final Volume : 5ml
Prepared by : SCerva Analyzed by : SCerva

METHOD 5030B/8015B
TOTAL PETROLEUM HYDROCARBONS BY PURGE AND TRAP

=====
Client : EUROFINS EATON ANALYTICAL Date Collected: 01/06/22 08:55
Project : 979003 Date Received: 01/11/22
Batch No. : 22A078 Date Extracted: 01/11/22 22:45
Sample ID : 202201070100 Date Analyzed: 01/11/22 22:45
Lab Samp ID: A078-02 Dilution Factor: 1
Lab File ID: EA11022A Matrix: WATER
Ext Btch ID: 22VG39A06 % Moisture: NA
Calib. Ref.: EA11012A Instrument ID: 39
=====

PARAMETERS	RESULTS (mg/L)	RL (mg/L)	MDL (mg/L)	
GASOLINE	ND	0.020	0.010	
SURROGATE PARAMETERS	RESULT	SPK_AMT	%RECOVERY	QC LIMIT
Bromofluorobenzene	0.0317	0.0400	79	60-140

Notes:

Parameter H-C Range
Gasoline C6-C10
Reported ND at RL quantitated per pattern recognition.

Detection limits are reported relative to sample result significant figures.
Sample Amount : 5ml Final Volume : 5ml
Prepared by : SCerva Analyzed by : SCerva

METHOD 5030B/8015B
TOTAL PETROLEUM HYDROCARBONS BY PURGE AND TRAP

```
=====
Client       : EUROFINS EATON ANALYTICAL   Date Collected: 01/06/22 08:30
Project      : 979003                      Date Received: 01/11/22
Batch No.    : 22A078                      Date Extracted: 01/12/22 00:34
Sample ID    : 202201070101               Date Analyzed: 01/12/22 00:34
Lab Samp ID  : A078-03                    Dilution Factor: 1
Lab File ID  : EA11025A                   Matrix: WATER
Ext Btch ID  : 22VG39A06                  % Moisture: NA
Calib. Ref.  : EA11023A                   Instrument ID: 39
=====
```

PARAMETERS	RESULTS (mg/L)	RL (mg/L)	MDL (mg/L)	
GASOLINE	ND	0.020	0.010	
SURROGATE PARAMETERS	RESULT	SPK_AMT	%RECOVERY	QC LIMIT
Bromofluorobenzene	0.0325	0.0400	81	60-140

Notes:

Parameter H-C Range
Gasoline C6-C10

Reported ND at RL quantitated per pattern recognition.

Detection limits are reported relative to sample result significant figures.

Sample Amount : 5ml Final Volume : 5ml
Prepared by : SCerva Analyzed by : SCerva

METHOD 5030B/8015B
TOTAL PETROLEUM HYDROCARBONS BY PURGE AND TRAP

```

=====
Client      : EUROFINS EATON ANALYTICAL   Date Collected: 01/06/22 08:30
Project    : 979003                       Date Received: 01/11/22
Batch No.  : 22A078                       Date Extracted: 01/12/22 01:11
Sample ID  : 202201070102                 Date Analyzed: 01/12/22 01:11
Lab Samp ID: A078-04                       Dilution Factor: 1
Lab File ID: EA11026A                       Matrix: WATER
Ext Btch ID: 22VG39A06                      % Moisture: NA
Calib. Ref.: EA11023A                       Instrument ID: 39
=====
  
```

PARAMETERS	RESULTS (mg/L)	RL (mg/L)	MDL (mg/L)	
GASOLINE	ND	0.020	0.010	
SURROGATE PARAMETERS				
	RESULT	SPK_AMT	%RECOVERY	QC LIMIT
Bromofluorobenzene	0.0323	0.0400	81	60-140

Notes:
 Parameter H-C Range
 Gasoline C6-C10
 Reported ND at RL quantitated per pattern recognition.

Detection limits are reported relative to sample result significant figures.
 Sample Amount : 5ml Final Volume : 5ml
 Prepared by : SCerva Analyzed by : SCerva

QC SUMMARIES

METHOD 5030B/8015B
TOTAL PETROLEUM HYDROCARBONS BY PURGE AND TRAP

```

=====
Client      : EUROFINS EATON ANALYTICAL   Date Collected: 01/11/22 12:24
Project     : 979003                     Date Received: 01/11/22
Batch No.   : 22A078                     Date Extracted: 01/11/22 12:24
Sample ID   : MBLK1W                     Date Analyzed: 01/11/22 12:24
Lab Samp ID: VG39A06B                    Dilution Factor: 1
Lab File ID: EA11005A                    Matrix: WATER
Ext Btch ID: 22VG39A06                   % Moisture: NA
Calib. Ref.: EA11003A                    Instrument ID: 39
=====

```

PARAMETERS	RESULTS (mg/L)	RL (mg/L)	MDL (mg/L)	
GASOLINE	ND	0.020	0.010	
SURROGATE PARAMETERS	RESULT	SPK_AMT	%RECOVERY	QC LIMIT
Bromofluorobenzene	0.0313	0.0400	78	60-140

Notes:

Parameter H-C Range
Gasoline C6-C10
Reported ND at RL quantitated per pattern recognition.

Detection limits are reported relative to sample result significant figures.
Sample Amount : 5ml Final Volume : 5ml
Prepared by : SCerva Analyzed by : SCerva

EMAX QUALITY CONTROL DATA
LAB CONTROL SAMPLE ANALYSIS

CLIENT : EUROFINS EATON ANALYTICAL
PROJECT : 979003
BATCH NO. : 22A078
METHOD : 5030B/8015B

```

=====
MATRIX      : WATER                               % MOISTURE:NA
DILUTION FACTOR: 1                               1
SAMPLE ID   : MBLK1W                             LCS1W         LCD1W
LAB SAMPLE ID : VG39A06B                         VG39A06L      VG39A06C
LAB FILE ID  : EA11005A                         EA11006A      EA11007A
DATE PREPARED : 01/11/22 12:24                 01/11/22 13:00 01/11/22 13:37
DATE ANALYZED : 01/11/22 12:24                 01/11/22 13:00 01/11/22 13:37
PREP BATCH   : 22VG39A06                       22VG39A06     22VG39A06
CALIBRATION REF: EA11003A                      EA11003A      EA11003A
  
```

ACCESSION:

PARAMETERS	MBResult (mg/L)	SpikeAmt (mg/L)	LCSResult (mg/L)	LCSRec (%)	SpikeAmt (mg/L)	LCDResult (mg/L)	LCDRec (%)	RPD (%)	QCLimit (%)	MaxRPD (%)
Gasoline	ND	0.500	0.486	97	0.500	0.473	95	3	60-130	30

SURROGATE PARAMETER	SpikeAmt (mg/L)	LCSResult (mg/L)	LCSRec (%)	SpikeAmt (mg/L)	LCDResult (mg/L)	LCDRec (%)	QCLimit (%)
Bromofluorobenzene	0.0400	0.0418	105	0.0400	0.0418	105	70-130

MB: Method Blank sample LCS: Lab Control Sample LCD: Lab Control Sample Duplicate

EMAX QUALITY CONTROL DATA
MS/MSD ANALYSIS

CLIENT : EUROFINS EATON ANALYTICAL
PROJECT : 979196
BATCH NO. : 22A063
METHOD : 5030B/8015B

MATRIX	: WATER		% MOISTURE:NA
DILUTION FACTOR:	1	1	1
SAMPLE ID	: 202201100058	202201100058MS	202201100058MSD
LAB SAMPLE ID	: A063-01	A063-01M	A063-01S
LAB FILE ID	: EA11008A	EA11009A	EA11010A
DATE PREPARED	: 01/11/22 14:13	01/11/22 14:50	01/11/22 15:26
DATE ANALYZED	: 01/11/22 14:13	01/11/22 14:50	01/11/22 15:26
PREP BATCH	: 22VG39A06	22VG39A06	22VG39A06
CALIBRATION REF:	EA11003A	EA11003A	EA11003A

ACCESSION:

PARAMETERS	PSResult (mg/L)	SpikeAmt (mg/L)	MSResult (mg/L)	MSRec (%)	SpikeAmt (mg/L)	MSDResult (mg/L)	MSDRec (%)	RPD (%)	QCLimit (%)	MaxRPD (%)
Gasoline	ND	0.500	0.472	94	0.500	0.466	93	1	50-130	30

SURROGATE PARAMETER	SpikeAmt (mg/L)	MSResult (mg/L)	MSRec (%)	SpikeAmt (mg/L)	MSDResult (mg/L)	MSDRec (%)	QCLimit (%)
Bromofluorobenzene	0.0400	0.0415	104	0.0400	0.0397	99	60-140

PS: Parent Sample MS: Matrix Spike MSD: Matrix Spike Duplicate

LABORATORY REPORT FOR

EUROFINS EATON ANALYTICAL

979003

METHOD 3520C/8015B
TOTAL PETROLEUM HYDROCARBONS BY EXTRACTION

SDG#: 22A078

CASE NARRATIVE

Client : EUROFINS EATON ANALYTICAL

Project: 979003

SDG : 22A078

METHOD 3520C/8015B
TOTAL PETROLEUM HYDROCARBONS BY EXTRACTION

A total of two(2) water samples were received on 01/11/22 to be analyzed for Total Petroleum Hydrocarbons by Extraction in accordance with Method 3520C/8015B and project specific requirements.

Holding Time

Samples were analyzed within the prescribed holding time.

Calibration

Multi-calibration points were generated to establish initial calibration (ICAL). ICAL was verified using a secondary source (ICV). Continuing calibration (CCV) verifications were carried out on a frequency specified by the project. All calibration requirements were within acceptance criteria. Refer to calibration summary forms of ICAL, ICV and CCV for details. MRL was analyzed as required by the project. Refer to MRL summary form for details.

Method Blank

Method blank was prepared and analyzed at the frequency required by the project. For this SDG, one(1) method blank was analyzed. DSA006WB - result was compliant to project requirement. Refer to sample result summary form for details.

Lab Control Sample

Lab control sample was prepared and analyzed at a frequency required by the project. For this SDG, one(1) LCS was analyzed. Percent recovery for Diesel was within LCS QC limits in DSA006WL. Refer to LCS summary form for details.

Matrix QC Sample

No matrix QC sample was provided on this SDG. One(1) set of MS/MSD was analyzed. Diesel was within MS QC limits in 22A063-01M/22A063-01S. Refer to Matrix QC summary form for details.

Surrogate

Surrogates were added on QC and field samples. All surrogate recoveries were within QC limits. Refer to sample result summary forms for details.

Sample Analysis

Samples were analyzed according to prescribed analytical procedures. Results were evaluated in accordance to project requirements. For this SDG, all quality control requirements were met.

CASE NARRATIVE

Client : EUROFINS EATON ANALYTICAL

Project: 979003

SDG : 22A078

METHOD 3520C/8015B
PETROLEUM HYDROCARBONS BY EXTRACTION

A total of two (2) water samples were received on 01/11/22 to be analyzed for Petroleum Hydrocarbons by Extraction in accordance with Method 3520C/8015B and project specific requirements.

Holding Time

Samples were analyzed within the prescribed holding time.

Calibration

Multi-calibration points were generated to establish initial calibration (ICAL). ICAL was verified using a secondary source (ICV). Continuing calibration (CCV) verifications were carried out on a frequency specified by the project. All calibration requirements were within acceptance criteria. Refer to calibration summary forms of ICAL, ICV and CCV for details. MRL was analyzed as required by the project. Refer to MRL summary form for details.

Method Blank

Method blank was prepared and analyzed at the frequency required by the project. For this SDG, one (1) method blank was analyzed. DSA006WB - result was compliant to project requirement. Refer to sample result summary form for details.

Lab Control Sample

Lab control sample was prepared and analyzed at a frequency required by the project. For this SDG, one (1) LCS was analyzed. Percent recovery for JP5 was within LCS QC limits in J5A006WL. Refer to LCS summary form for details.

Matrix QC Sample

No matrix QC sample was provided on this SDG. One (1) set of MS/MSD was analyzed. JP5 was within MS QC limits in 22A063-03M/22A063-03S. Refer to Matrix QC summary form for details.

Surrogate

Surrogates were added on QC and field samples. All surrogate recoveries were within QC limits. Refer to sample result summary forms for details.

Sample Analysis

Samples were analyzed according to prescribed analytical procedures. Results were evaluated in accordance to project requirements. For this SDG, all quality control requirements were met.

CASE NARRATIVE

Client : EUROFINS EATON ANALYTICAL

Project: 979003

SDG : 22A078

METHOD 3520C/8015B
PETROLEUM HYDROCARBONS BY EXTRACTION

A total of two(2) water samples were received on 01/11/22 to be analyzed for Petroleum Hydrocarbons by Extraction in accordance with Method 3520C/8015B and project specific requirements.

Holding Time

Samples were analyzed within the prescribed holding time.

Calibration

Multi-calibration points were generated to establish initial calibration (ICAL). ICAL was verified using a secondary source (ICV). Continuing calibration (CCV) verifications were carried out on a frequency specified by the project. All calibration requirements were within acceptance criteria. Refer to calibration summary forms of ICAL, ICV and CCV for details. MRL was analyzed as required by the project. Refer to MRL summary form for details.

Method Blank

Method blank was prepared and analyzed at the frequency required by the project. For this SDG, one(1) method blank was analyzed. DSA006WB - result was compliant to project requirement. Refer to sample result summary form for details.

Lab Control Sample

Lab control sample was prepared and analyzed at a frequency required by the project. For this SDG, one(1) LCS was analyzed. Percent recovery for JP8 was within LCS QC limits in J8A006WL. Refer to LCS summary form for details.

Matrix QC Sample

No matrix QC sample was provided on this SDG. One(1) set of MS/MSD was analyzed. JP8 was within MS QC limits in 22A077-01M/22A077-01S. Refer to Matrix QC summary form for details.

Surrogate

Surrogates were added on QC and field samples. All surrogate recoveries were within QC limits. Refer to sample result summary forms for details.

Sample Analysis

Samples were analyzed according to prescribed analytical procedures. Results were evaluated in accordance to project requirements. For this SDG, all quality control requirements were met.

LAB CHRONICLE
TOTAL PETROLEUM HYDROCARBONS BY EXTRACTION

```

=====
Client      : EUROFINS EATON ANALYTICAL
Project     : 979003
SDG NO.    : 22A078
Instrument ID : D5
=====

```

Client Sample ID	Laboratory Sample ID	Dilution Factor	% Moist	WATER		Extraction DateTime	Sample Data FN	Calibration Data FN	Prep. Batch	Notes
				Analysis DateTime	Extraction DateTime					
MBLK1W	DSA006WB	1	NA	01/13/2213:15	01/12/2214:00	LA13010A	LA13004A	22DSA006W	Method Blank	
LGS1W	DSA006WL	1	NA	01/13/2213:33	01/12/2214:00	LA13011A	LA13004A	22DSA006W	Lab Control Sample (LCS)	
202201070099	A078-01	1	NA	01/13/2217:41	01/12/2214:00	LA13025A	LA13004A	22DSA006W	Field Sample	
202201070101	A078-03	1	NA	01/13/2217:58	01/12/2214:00	LA13026A	LA13004A	22DSA006W	Field Sample	

```

FN          - Filename
% Moist     - Percent Moisture

```

LAB CHRONICLE
PETROLEUM HYDROCARBONS BY EXTRACTION

```

=====
Client      : EUROFINS EATON ANALYTICAL
Project     : 979003
=====
SDG NO.    : 22A078
Instrument ID : D5
=====

```

Client Sample ID	Laboratory Sample ID	Dilution Factor	% Moist	WATER		Extraction Date/Time	Sample Data FN	Calibration Data FN	Prep. Batch	Notes
				Analysis Date/Time	Extraction Date/Time					
MBLK1W	DSA006WB	1	NA	01/13/2213:15	01/12/2214:00	LA13010A	LA13005A	22DSA006W	Method Blank	
LCS1W	J5A006WL	1	NA	01/13/2213:50	01/12/2214:00	LA13012A	LA13005A	22DSA006W	Lab Control Sample (LCS)	
202201070099	A078-01	1	NA	01/13/2217:41	01/12/2214:00	LA13025A	LA13005A	22DSA006W	Field Sample	
202201070101	A078-03	1	NA	01/13/2217:58	01/12/2214:00	LA13026A	LA13005A	22DSA006W	Field Sample	

FN - Filename
% Moist - Percent Moisture

SAMPLE RESULTS

METHOD 3520C/8015B
TOTAL PETROLEUM HYDROCARBONS BY EXTRACTION

=====
Client : EUROFINS EATON ANALYTICAL Date Collected: 01/06/22 08:55
Project : 979003 Date Received: 01/11/22
Batch No. : 22A078 Date Extracted: 01/12/22 14:00
Sample ID : 202201070099 Date Analyzed: 01/13/22 17:41
Lab Samp ID: 22A078-01 Dilution Factor: 1
Lab File ID: LA13025A Matrix: WATER
Ext Btch ID: 22DSA006W % Moisture: NA
Calib. Ref.: LA13004A Instrument ID: D5
=====

PARAMETERS	RESULTS (mg/L)	RL (mg/L)	MDL (mg/L)
Diesel	ND	0.027	0.014
Motor Oil	ND	0.054	0.027

SURROGATE PARAMETERS	RESULT	SPK_AMT	%RECOVERY	QC LIMIT
Bromobenzene	0.517	0.540	96	60-130
Hexacosane	0.132	0.135	98	60-130

Notes:

Parameter H-C Range
Diesel C10-C24
Motor Oil C24-C36

Reported ND at RL quantitated per pattern recognition.

Detection limits are reported relative to sample result significant figures.

Sample Amount : 930ml Final Volume : 5ml
Prepared by : JMuert Analyzed by : SDeeso

METHOD 3520C/8015B
 PETROLEUM HYDROCARBONS BY EXTRACTION

```

=====
Client      : EUROFINS EATON ANALYTICAL   Date Collected: 01/06/22 08:55
Project     : 979003                      Date Received: 01/11/22
Batch No.   : 22A078                      Date Extracted: 01/12/22 14:00
Sample ID   : 202201070099              Date Analyzed: 01/13/22 17:41
Lab Samp ID: 22A078-01                  Dilution Factor: 1
Lab File ID: LA13025A                    Matrix: WATER
Ext Btch ID: 22DSA006W                   % Moisture: NA
Calib. Ref.: LA13005A                    Instrument ID: D5
=====
  
```

PARAMETERS	RESULTS (mg/L)	RL (mg/L)	MDL (mg/L)	
JP5	ND	0.054	0.027	
SURROGATE PARAMETERS	RESULT	SPK_AMT	%RECOVERY	QC LIMIT
Bromobenzene	0.517	0.540	96	60-130
Hexacosane	0.132	0.135	98	60-130

Notes:

RL : Reporting Limit
 Parameter H-C Range
 JP5 C8-C18
 Reported ND at RL quantitated per pattern recognition.

Detection limits are reported relative to sample result significant figures.
 Sample Amount : 930ml Final Volume : 5ml
 Prepared by : JMuert Analyzed by : SDeeso

METHOD 3520C/8015B
 PETROLEUM HYDROCARBONS BY EXTRACTION

```

=====
Client      : EUROFINS EATON ANALYTICAL   Date Collected: 01/06/22 08:55
Project    : 979003                      Date Received: 01/11/22
Batch No.  : 22A078                      Date Extracted: 01/12/22 14:00
Sample ID  : 202201070099                Date Analyzed: 01/13/22 17:41
Lab Samp ID: 22A078-01                   Dilution Factor: 1
Lab File ID: LA13025A                    Matrix: WATER
Ext Btch ID: 22DSA006W                   % Moisture: NA
Calib. Ref.: LA13006A                    Instrument ID: D5
=====
  
```

PARAMETERS	RESULTS (mg/L)	RL (mg/L)	MDL (mg/L)
JP8	ND	0.054	0.027

SURROGATE PARAMETERS	RESULT	SPK_AMT	%RECOVERY	QC LIMIT
Bromobenzene	0.517	0.540	96	60-130
Hexacosane	0.132	0.135	98	60-130

Notes:

RL : Reporting Limit
 Parameter H-C Range
 JP8 C8-C18

Reported ND at RL quantitated per pattern recognition.

Detection limits are reported relative to sample result significant figures.

Sample Amount : 930ml Final Volume : 5ml
 Prepared by : JMuert Analyzed by : SDeeso

METHOD 3520C/8015B
TOTAL PETROLEUM HYDROCARBONS BY EXTRACTION

```

=====
Client      : EUROFINS EATON ANALYTICAL    Date Collected: 01/06/22 08:30
Project     : 979003                      Date Received: 01/11/22
Batch No.   : 22A078                      Date Extracted: 01/12/22 14:00
Sample ID   : 202201070101               Date Analyzed: 01/13/22 17:58
Lab Samp ID: 22A078-03                   Dilution Factor: 1
Lab File ID: LA13026A                    Matrix: WATER
Ext Btch ID: 22DSA006W                    % Moisture: NA
Calib. Ref.: LA13004A                    Instrument ID: D5
=====

```

PARAMETERS	RESULTS (mg/L)	RL (mg/L)	MDL (mg/L)		
Diesel	ND	0.025	0.012		
Motor Oil	ND	0.050	0.025		
SURROGATE PARAMETERS	RESULT	SPK_AMT	%RECOVERY	QC LIMIT	
Bromobenzene	0.481	0.500	96	60-130	
Hexacosane	0.119	0.125	96	60-130	

Notes:

Parameter H-C Range
Diesel C10-C24
Motor Oil C24-C36

Reported ND at RL quantitated per pattern recognition.

Detection limits are reported relative to sample result significant figures.

Sample Amount : 1000ml Final Volume : 5ml
Prepared by : JMuert Analyzed by : SDeeso

METHOD 3520C/8015B
 PETROLEUM HYDROCARBONS BY EXTRACTION

```

=====
Client      : EUROFINS EATON ANALYTICAL   Date Collected: 01/06/22 08:30
Project     : 979003                      Date Received: 01/11/22
Batch No.   : 22A078                      Date Extracted: 01/12/22 14:00
Sample ID   : 202201070101               Date Analyzed: 01/13/22 17:58
Lab Samp ID : 22A078-03                  Dilution Factor: 1
Lab File ID : LA13026A                   Matrix: WATER
Ext Btch ID : 22DSA006W                  % Moisture: NA
Calib. Ref. : LA13005A                   Instrument ID: D5
=====
    
```

PARAMETERS	RESULTS (mg/L)	RL (mg/L)	MDL (mg/L)
JP5	ND	0.050	0.025

SURROGATE PARAMETERS	RESULT	SPK_AMT	%RECOVERY	QC LIMIT
Bromobenzene	0.481	0.500	96	60-130
Hexacosane	0.119	0.125	96	60-130

Notes:

RL : Reporting Limit
 Parameter H-C Range
 JP5 C8-C18
 Reported ND at RL quantitated per pattern recognition.

Detection limits are reported relative to sample result significant figures.
 Sample Amount : 1000ml Final Volume : 5ml
 Prepared by : JMuert Analyzed by : SDeeso

METHOD 3520C/8015B
 PETROLEUM HYDROCARBONS BY EXTRACTION

```

=====
Client      : EUROFINS EATON ANALYTICAL   Date Collected: 01/06/22 08:30
Project     : 979003                     Date Received: 01/11/22
Batch No.   : 22A078                     Date Extracted: 01/12/22 14:00
Sample ID   : 202201070101              Date Analyzed: 01/13/22 17:58
Lab Samp ID: 22A078-03                   Dilution Factor: 1
Lab File ID: LA13026A                    Matrix: WATER
Ext Btch ID: 22DSA006W                   % Moisture: NA
Calib. Ref.: LA13006A                    Instrument ID: D5
=====
  
```

PARAMETERS	RESULTS (mg/L)	RL (mg/L)	MDL (mg/L)	
JP8	ND	0.050	0.025	
SURROGATE PARAMETERS	RESULT	SPK_AMT	%RECOVERY	QC LIMIT
Bromobenzene	0.481	0.500	96	60-130
Hexacosane	0.119	0.125	96	60-130

Notes:

RL : Reporting Limit
 Parameter H-C Range
 JP8 CB-C18
 Reported ND at RL quantitated per pattern recognition.

Detection limits are reported relative to sample result significant figures.
 Sample Amount : 1000ml Final Volume : 5ml
 Prepared by : JMuert Analyzed by : SDeeso

QC SUMMARIES

METHOD 3520C/8015B
TOTAL PETROLEUM HYDROCARBONS BY EXTRACTION

```

=====
Client      : EUROFINS EATON ANALYTICAL   Date Collected: 01/12/22 14:00
Project     : 979003                      Date Received: 01/12/22
Batch No.   : 22A078                      Date Extracted: 01/12/22 14:00
Sample ID   : MBLK1W                      Date Analyzed: 01/13/22 13:15
Lab Samp ID: DSA006WB                    Dilution Factor: 1
Lab File ID: LA13010A                    Matrix: WATER
Ext Btch ID: 22DSA006W                   % Moisture: NA
Calib. Ref.: LA13004A                    Instrument ID: D5
=====

```

PARAMETERS	RESULTS (mg/L)	RL (mg/L)	MDL (mg/L)	
Diesel	ND	0.025	0.012	
Motor Oil	ND	0.050	0.025	
SURROGATE PARAMETERS	RESULT	SPK_AMT	%RECOVERY	QC LIMIT
Bromobenzene	0.395	0.500	79	60-130
Hexacosane	0.115	0.125	92	60-130

Notes:

Parameter H-C Range
Diesel C10-C24
Motor Oil C24-C36

Reported ND at RL quantitated per pattern recognition.

Detection limits are reported relative to sample result significant figures.

Sample Amount : 1000ml Final Volume : 5ml
Prepared by : JMuert Analyzed by : SDeeso

EMAX QUALITY CONTROL DATA
LAB CONTROL SAMPLE ANALYSIS

CLIENT : EUROFINS EATON ANALYTICAL
PROJECT : 979003
BATCH NO. : 22A078
METHOD : 3520C/8015B

=====

MATRIX	: WATER	% MOISTURE:NA
DILUTION FACTOR:	1	1
SAMPLE ID	: MBLK1W	LCS1W
LAB SAMPLE ID	: DSA006WB	DSA006WL
LAB FILE ID	: LA13010A	LA13011A
DATE PREPARED	: 01/12/22 14:00	01/12/22 14:00
DATE ANALYZED	: 01/13/22 13:15	01/13/22 13:33
PREP BATCH	: 22DSA006W	22DSA006W
CALIBRATION REF:	LA13004A	LA13004A

ACCESSION:

PARAMETERS	MBResult (mg/L)	SpikeAmt (mg/L)	LCSResult (mg/L)	LCSRec (%)	QCLimit (%)
-----	-----	-----	-----	-----	-----
Diesel	ND	2.50	2.18	87	50-130

SURROGATE PARAMETERS	SpikeAmt (mg/L)	LCSResult (mg/L)	LCSRec (%)	QCLimit (%)
-----	-----	-----	-----	-----
Bromobenzene	0.500	0.420	84	60-130
Hexacosane	0.125	0.119	95	60-130

=====

MB: Method Blank sample LCS: Lab Control Sample

METHOD 3520C/8015B
 PETROLEUM HYDROCARBONS BY EXTRACTION

```

=====
Client      : EUROFINS EATON ANALYTICAL   Date Collected: 01/12/22 14:00
Project    : 979003                      Date Received: 01/12/22
Batch No.  : 22A078                      Date Extracted: 01/12/22 14:00
Sample ID  : MBLK1W                      Date Analyzed: 01/13/22 13:15
Lab Samp ID: DSA006WB                   Dilution Factor: 1
Lab File ID: LA13010A                   Matrix: WATER
Ext Btch ID: 22DSA006W                  % Moisture: NA
Calib. Ref.: LA13005A                   Instrument ID: D5
=====
    
```

PARAMETERS	RESULTS (mg/L)	RL (mg/L)	MDL (mg/L)
JP5	ND	0.050	0.025

SURROGATE PARAMETERS	RESULT	SPK_AMT	%RECOVERY	QC LIMIT
Bromobenzene	0.395	0.500	79	60-130
Hexacosane	0.115	0.125	92	60-130

Notes:

RL : Reporting Limit
 Parameter H-C Range
 JP5 C8-C18
 Reported ND at RL quantitated per pattern recognition.

Detection limits are reported relative to sample result significant figures.
 Sample Amount : 1000ml Final Volume : 5ml
 Prepared by : JMuert Analyzed by : SDeeso

EMAX QUALITY CONTROL DATA
LAB CONTROL SAMPLE ANALYSIS

CLIENT : EUROFINS EATON ANALYTICAL
PROJECT : 979003
BATCH NO. : 22A078
METHOD : 3520C/8015B

=====

MATRIX	: WATER	% MOISTURE:NA
DILUTION FACTOR:	1	1
SAMPLE ID	: MBLK1W	LCS1W
LAB SAMPLE ID	: DSA006WB	J5A006WL
LAB FILE ID	: LA13010A	LA13012A
DATE PREPARED	: 01/12/22 14:00	01/12/22 14:00
DATE ANALYZED	: 01/13/22 13:15	01/13/22 13:50
PREP BATCH	: 22DSA006W	22DSA006W
CALIBRATION REF:	LA13005A	LA13005A

ACCESSION:

PARAMETERS	MBResult (mg/L)	SpikeAmt (mg/L)	LCSResult (mg/L)	LCSRec (%)	QCLimit (%)
-----	-----	-----	-----	-----	-----
JP5	ND	2.50	1.80	72	30-160

SURROGATE PARAMETERS	SpikeAmt (mg/L)	LCSResult (mg/L)	LCSRec (%)	QCLimit (%)
-----	-----	-----	-----	-----
Bromobenzene	0.500	0.456	91	60-130
Hexacosane	0.125	0.122	98	60-130

=====

MB: Method Blank sample LCS: Lab Control Sample

METHOD 3520C/8015B
 PETROLEUM HYDROCARBONS BY EXTRACTION

```

=====
Client      : EUROFINS EATON ANALYTICAL   Date Collected: 01/12/22 14:00
Project     : 979003                     Date Received: 01/12/22
Batch No.   : 22A078                     Date Extracted: 01/12/22 14:00
Sample ID   : MBLK1W                     Date Analyzed: 01/13/22 13:15
Lab Samp ID : DSA006WB                   Dilution Factor: 1
Lab File ID : LA13010A                   Matrix: WATER
Ext Btch ID : 22DSA006W                  % Moisture: NA
Calib. Ref. : LA13006A                   Instrument ID: D5
=====
  
```

PARAMETERS	RESULTS (mg/L)	RL (mg/L)	MDL (mg/L)
JP8	ND	0.050	0.025

SURROGATE PARAMETERS	RESULT	SPK_AMT	%RECOVERY	QC LIMIT
Bromobenzene	0.395	0.500	79	60-130
Hexacosane	0.115	0.125	92	60-130

Notes:

RL : Reporting Limit

Parameter H-C Range

JP8 C8-C18

Reported ND at RL quantitated per pattern recognition.

Detection limits are reported relative to sample result significant figures.

Sample Amount : 1000ml

Final Volume : 5ml

Prepared by : JMuert

Analyzed by : SDeeso

EMAX QUALITY CONTROL DATA
LAB CONTROL SAMPLE ANALYSIS

CLIENT : EUROFINS EATON ANALYTICAL
PROJECT : 979003
BATCH NO. : 22A078
METHOD : 3520C/8015B

MATRIX : WATER % MOISTURE:NA
DILUTION FACTOR: 1 1
SAMPLE ID : MBLK1W LCS1W
LAB SAMPLE ID : DSA006WB J8A006WL
LAB FILE ID : LA13010A LA13013A
DATE PREPARED : 01/12/22 14:00 01/12/22 14:00
DATE ANALYZED : 01/13/22 13:15 01/13/22 14:08
PREP BATCH : 22DSA006W 22DSA006W
CALIBRATION REF: LA13006A LA13006A

ACCESSION:

PARAMETERS	MBResult (mg/L)	SpikeAmt (mg/L)	LCSResult (mg/L)	LCSRec (%)	QCLimit (%)
JP8	ND	2.50	1.79	72	30-160

SURROGATE PARAMETERS	SpikeAmt (mg/L)	LCSResult (mg/L)	LCSRec (%)	QCLimit (%)
Bromobenzene	0.500	0.491	98	60-130
Hexacosane	0.125	0.130	104	60-130

MB: Method Blank sample LCS: Lab Control Sample

EMAX QUALITY CONTROL DATA
MS/MSD ANALYSIS

CLIENT : EUROFINS EATON ANALYTICAL
PROJECT : 979196
BATCH NO. : 22A063
METHOD : 3520C/8015B

```

=====
MATRIX      : WATER                               % MOISTURE:NA
DILUTION FACTOR: 1                               1
SAMPLE ID   : 202201100058                       202201100058MSD
LAB SAMPLE ID : 22A063-01                         22A063-01S
LAB FILE ID  : LA13014A                           LA13016A
DATE PREPARED : 01/12/22 14:00                   01/12/22 14:00
DATE ANALYZED : 01/13/22 14:26                   01/13/22 15:01
PREP BATCH   : 22DSA006W                          22DSA006W
CALIBRATION REF: LA13004A                         LA13004A
=====

```

ACCESSION:

PARAMETERS	PSResult (mg/L)	SpikeAmt (mg/L)	MSResult (mg/L)	MSRec (%)	SpikeAmt (mg/L)	MSDResult (mg/L)	MSDRec (%)	RPD (%)	QCLimit (%)	MaxRPD (%)
Diesel	ND	2.50	2.08	83	2.45	2.45	100	16	50-130	30

SURROGATE PARAMETERS	SpikeAmt (mg/L)	MSResult (mg/L)	MSRec (%)	SpikeAmt (mg/L)	MSDResult (mg/L)	MSDRec (%)	QCLimit (%)
Bromobenzene	0.500	0.407	81	0.490	0.480	98	60-130
Hexacosane	0.125	0.120	96	0.123	0.116	95	60-130

PS: Parent Sample MS: Matrix Spike MSD: Matrix Spike Duplicate

EMAX QUALITY CONTROL DATA
MS/MSD ANALYSIS

CLIENT : EUROFINS EATON ANALYTICAL
PROJECT : 979196
BATCH NO. : 22A063
METHOD : 3520C/8015B

```

=====
MATRIX      : WATER                                     % MOISTURE:NA
DILUTION FACTOR: 1                                     1
SAMPLE ID   : 202201100060                             202201100060MSD
LAB SAMPLE ID : 22A063-03                             22A063-03S
LAB FILE ID  : LA13017A                               LA13019A
DATE PREPARED : 01/12/22 14:00                       01/12/22 14:00
DATE ANALYZED : 01/13/22 15:19                       01/13/22 15:54
PREP BATCH   : 22DSA006W                             22DSA006W
CALIBRATION REF: LA13005A                             LA13005A
  
```

ACCESSION:

PARAMETERS	PSResult (mg/L)	SpikeAmt (mg/L)	MSResult (mg/L)	MSRec (%)	SpikeAmt (mg/L)	MSDResult (mg/L)	MSDRec (%)	RPD (%)	QCLimit (%)	MaxRPD (%)
JP5	ND	2.58	2.05	80	2.60	2.35	90	14	30-160	30

SURROGATE PARAMETERS	SpikeAmt (mg/L)	MSResult (mg/L)	MSRec (%)	SpikeAmt (mg/L)	MSDResult (mg/L)	MSDRec (%)	QCLimit (%)
Bromobenzene	0.515	0.454	88	0.520	0.500	96	60-130
Hexacosane	0.129	0.121	94	0.130	0.128	98	60-130

PS: Parent Sample MS: Matrix Spike MSD: Matrix Spike Duplicate

EMAX QUALITY CONTROL DATA
MS/MSD ANALYSIS

CLIENT : EUROFINS EATON ANALYTICAL
PROJECT : 979002
BATCH NO. : 22A077
METHOD : 3520C/8015B

```

=====
MATRIX      : WATER                                     % MOISTURE:NA
DILUTION FACTOR: 1                                     1
SAMPLE ID   : 202201070092                             202201070092MSD
LAB SAMPLE ID : 22A077-01                             22A077-01S
LAB FILE ID  : LA13020A                               LA13022A
DATE PREPARED : 01/12/22 14:00                       01/12/22 14:00
DATE ANALYZED : 01/13/22 16:12                       01/13/22 16:48
PREP BATCH   : 22DSA006W                              22DSA006W
CALIBRATION REF: LA13006A                             LA13006A
    
```

ACCESSION:

PARAMETERS	PSResult (mg/L)	SpikeAmt (mg/L)	MSResult (mg/L)	MSRec (%)	SpikeAmt (mg/L)	MSDResult (mg/L)	MSDRec (%)	RPD (%)	QCLimit (%)	MaxRPD (%)
JP8	ND	2.72	2.51	92	2.75	2.44	89	3	30-160	30

SURROGATE PARAMETERS	SpikeAmt (mg/L)	MSResult (mg/L)	MSRec (%)	SpikeAmt (mg/L)	MSDResult (mg/L)	MSDRec (%)	QCLimit (%)
Bromobenzene	0.545	0.633	116	0.550	0.620	113	60-130
Hexacosane	0.136	0.130	95	0.138	0.139	101	60-130

PS: Parent Sample MS: Matrix Spike MSD: Matrix Spike Duplicate